

Desigo™ RXC

Room controller

RXC39.5

Communicating room controller
for fan-coil applications

The RXC39.5 room controller is used for temperature control in individual rooms.

- For fan-coil systems with ECM fan
- PI / PID control (depending on application)
- Downloadable application software
- LONMARK®-compatible bus communications
- For use in the Desigo building automation and control system
- 0 ... 10 V control of valve actuators, fan, and electric heating coil
- Volt-free relay contacts for release of the fan and the electric heating coil
- Commissioning with RXT10 or standard LONWORKS tool
- AC 24 V operating voltage
- Pluggable screw terminals

Use

The RXC39.5 room controller is optimized for control of fan-coil systems with ECM fans in individual rooms.

The controller application is determined by downloadable application software, also referred to simply as the “application”. The various applications and the associated functions are described in detail in the applications library: CA110300.

The controller is delivered with basic application 00039. The basic application, which contains only I/O module functions, is overwritten with the definitive application in the commissioning phase. The RXT10 commissioning and service tool is used for this purpose (see “Commissioning”).

Use as an I/O module

In conjunction with a building automation and control system, the RXC39.5 controller can also be used as a universal I/O module, e.g. to register digital signals or to control various equipment (ON/OFF or modulating). In this case the controller is loaded with basic application 00039. The inputs can then be read and the outputs overridden via the building automation and control system.

Functions

The controller functions are determined by the selected application and its parameters. For a detailed description of functions refer to the Desigo RXC applications library CA110300.

Ordering

<i>Product number</i>	<i>Stock number</i>	<i>Designation</i>
RXC39.5	S55373-C101	Room controller

Accessories

RXZ30.1	Terminal covers
---------	-----------------


Equipment combinations

The RXC39.5 room controller is compatible with field devices from Siemens Building Technologies.

For details, refer to the Desigo RX hardware overview, CA2N3804


Technical design

The RXC39.5 controller consists of a housing base, a housing cover and the printed circuit board with connection terminals. The controller also has a tool socket, a programming LED and a programming button.

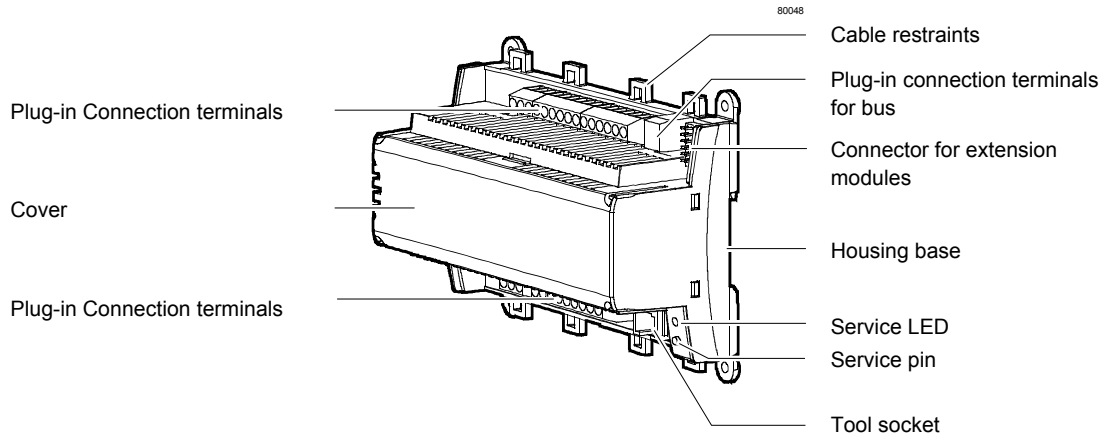

Terminal cover

Terminal covers (RXZ30.1) are available as an option, to protect the connection terminals from physical contact and dirt. The programming LED remains visible when the terminal covers are in place, and the programming button can be operated with a pointed implement.

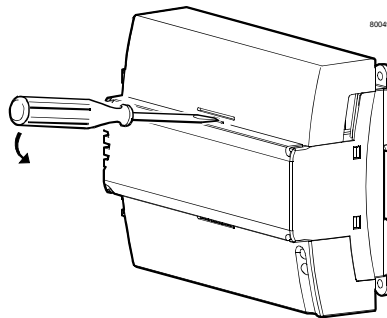

Removing the terminal cover

Label

Bar code, Code 39 (ID number)

Protection standard

Temperature range (0 ... 50 °C)

Test date, series (A, B, C...)

Serial No.

Neuron ID

Definitively loaded application

Location

SIEMENS
RXC39.5/00039
S55373-C118
Origin: Switzerland
Siemens Switzerland Ltd

AC 24V~ 6VA
50/60Hz T50 IP20(30)
class 2
091112A 33725

1 2 3 4 5 6 7 8 9 10 11 12 13 14 15 16 17 18 19 20 21
G0 G0 G G G X1 M B2 M D1 GND D2 D3 GND D4 CP-CP+CLA CLB
AC 24V~

Q11 Q12 Q21 Q22 Y1 G Y2 G YC1 G YC2 G YC3 G YC4 G
22 23 24 25 26 27 28 29 30 31 32 33 34 35 36 37

0... 10V OUT 0... 10V OUT 0... 10V OUT 0... 10V OUT

Preloaded: Appl.:
Loc.:

CAUTION: Risk of electric shock. Multiple disconnect may be provided

3856Z06

E93189
Open Energy Management Equipment
75M5
UL LISTED US

ID: 001086169900 Hex

Note Options for use of the labeling fields "Appl." and "Loc.":


- Hand-written entry of the location and the actual application ... or
- Printed adhesive label (printed from the RXT10 commissioning and service tool)

Connection terminals

All connection terminals are detachable plug-in terminals. They are arranged so that, under normal circumstances, all incoming and outgoing cables can be connected without crossing.

Cable strain relief

The conductors to the connection terminals can be secured with cable ties to the housing base.

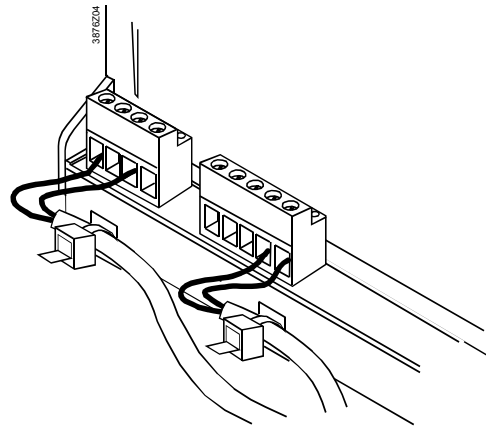


Communication

The RXC39.5 controller communicates with other devices via the following interfaces:

- LONWORKS bus (terminals CLA and CLB) for communication with:
 - the PXR system controller or the NIDES.RX interface (to Desigo)
 - other Desigo RXC devices
 - LONMARK-compatible third party devices (e.g. presence detector)
- PPS2 (terminals CP– and CP+):
 - Interface to the QAX... room units. (In addition to PPS2, the LONWORKS® bus is also looped to the tool socket on the room unit.)
- Tool socket (RJ45) on the controller or room unit, for:
 - RXT10 commissioning and service tool (LONWORKS® bus)
 - RXT20.1 service terminal (PPS2)

LONWORKS® bus

The diagram below shows the wiring of the LONWORKS® bus and PPS2 interface when a QAX... room unit is connected. It also shows the options for connecting the RXT10 commissioning and service tool and the RXT20.1 service terminal.

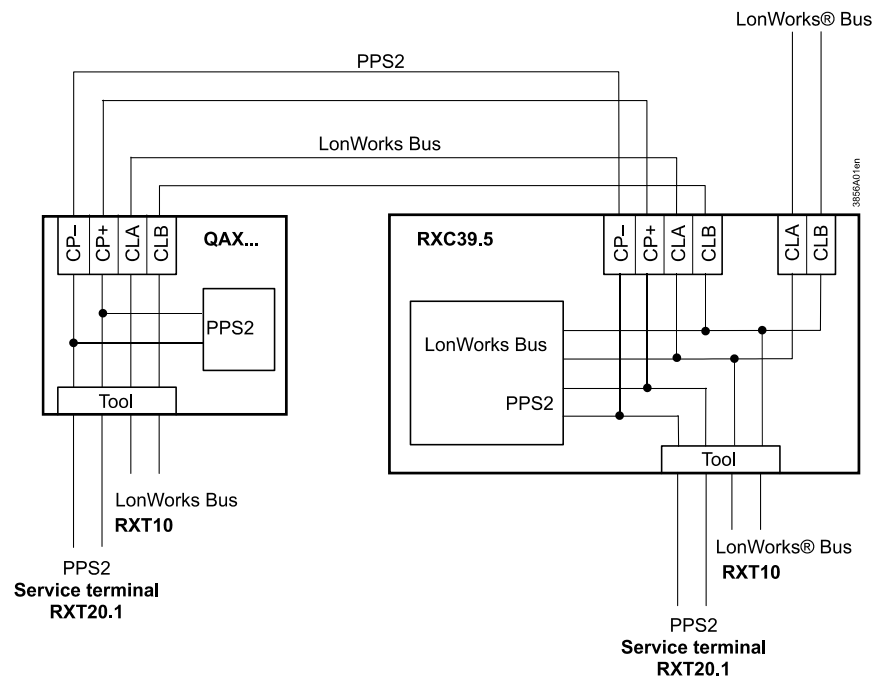

Service LED	The yellow service LED shows the current operational status of the controller by means of different flashing patterns (see the RXT10 user manual, CM110669).
Service pin	The service pin is used to identify the controller in the commissioning phase. When the pin is pressed the controller's identification number is transmitted to the RXT10 commissioning and service tool.

Disposal



The devices are classified as waste electronic equipment in terms of the European Directive 2002/96/EC (WEEE) and should not be disposed of as unsorted municipal waste.

The relevant national legal rules are to be adhered to.

Regarding disposal, use the systems setup for collecting electronic waste.

Observe all local and applicable laws.

Engineering notes

The Desigo RXC installation guide, document CA110334, contains the relevant engineering information for the LONWORKS® bus (topology, bus repeaters, bus termination, etc.) and for the selection and dimensions of connecting cables for the supply voltage and field devices.

See "Connection diagrams" for information on connecting field devices.

AC 24 V supply	<p>The controller operates with an AC 24 V supply voltage (SELV). The supply cable must be protected with at least 10 A.</p> <p>The controlled devices (valve / damper actuators) are supplied directly from the controller. The maximum load on the outputs must not be exceeded (see "Technical data"). The power consumption of the connected devices must be taken into account when sizing the transformer.</p>
-----------------------	--

RXC40.1 and RXC41.1 extension modules	<p>The plug-in connection for the extension modules incorporates both the communications and the power supply. The power supply is limited to a maximum of two extension modules. The possible combinations are determined by the available applications.</p> <p>See the Desigo RXC applications library, CA110300.</p>
--	---

Volt-free relay outputs AC 230 V	<ul style="list-style-type: none"> • The volt-free releasing relay output for the fan allows the switching of a load up to AC 250 V, 2(2) A. • The circuits must be externally fused (≤ 10 A) as there are no internal fuses. • The cables connected to the room controller must be secured with cable ties.
---	---

AC 24 V triac outputs

- The **simultaneous** load on outputs Y1, Y2 must not exceed 12 VA
- The maximum load on **each** output must not exceed 12 VA

Example

Equipment	Y1, Y2	2 thermic valve actuators, type STP72E	6 VA each
Simultaneous load:		2 thermic valve actuators *	$\frac{6 \text{ W (12 W) }^{**}}{6 \text{ W (12 W)}}$

- * The heating and cooling sequences are never operative simultaneously. Therefore only the actuators for one of the two sequences need to be included when calculating the total load.
- ** When cold, thermic valve actuators have a consumption of approximately 6 W. A maximum of two thermic actuators may be connected to any one Y.. output.

DC 0...10 V outputs


The DC 0...10 V control outputs YC...YC4 deliver max. 1.5 mA.

AC 24 V supply for field devices

The AC 24 V supply outputs for field devices (G, terminals 5, 27, 29, 33, 37)) may be charged with a total of max. 12 VA.


Mounting

The room controllers can be mounted in any orientation, and fixed as follows:

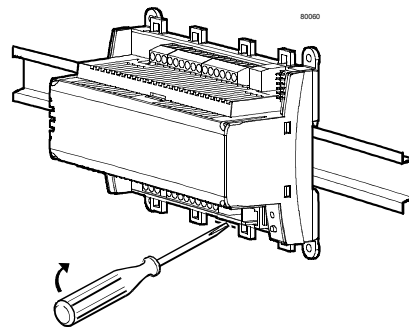

Rail mounting

The housing base is designed for snap-mounting on DIN rails, type EN50022-35x7.5 (can be released with a screwdriver)

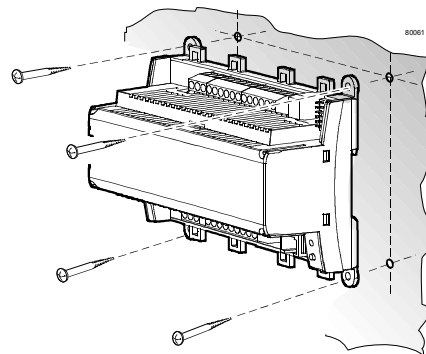

Surface mounting

There are four drill holes for screw-mounting (see "Dimensions" for drilling template). The housing base is fitted with raised supports.

When mounting note the following:

- The controller should not be freely accessible after mounting
- Ensure adequate air circulation to dissipate heat generated during operation.
- Easy access is required for service personnel
- Local installation regulations must be observed.

Mounting instructions and a drilling template are printed on the controller packaging.

Commissioning

The RXC39.5 controller is commissioned with the RXT10 commissioning and service tool. This is connected to the LONWORKS bus via a tool socket (on the controller or room unit).

The commissioning procedure for the entire Desigo RXC range is described in detail in the RXT10 user manual, document CM110669.

Labeling

The labeling fields “Appl.” and “Loc.” on the controller are used to indicate the application actually loaded and the location of the controller, either in writing or by use of printed adhesive labels (see “Label” under “Mechanical design”).

Function test

All applications (including basic application 00039) allow direct interrogation of the inputs and control of the outputs using the RXT10 commissioning and service tool. This makes it possible to test the installation and to operate connected plant provisionally before the complete Desigo RXC system is commissioned.

- Notes
- The LONWORKS bus plug (terminals 23 and 24) can be removed and reconnected at any time, even while the controller is in operation. Only the original bus plug may be used.
 - Overloading the triac outputs Y1, Y2 may cause the thermal fuse to trip and disable the controller. When the problem has been solved briefly disconnect and reconnect the power supply. The controller will resume normal operation after a delay of approximately 10 minutes.



Note!

Outputs Y1, Y2 are not protected against accidental connection to AC 24 V. This can damage the triacs.

Technical data

Power supply	Operating voltage	SELV / PELV AC 24 V ± 20 %
	Rated voltage	AC 24 V
	Frequency	50/60 Hz
	Power consumption	
	without field devices	6 VA
	with connected field devices	Max. 33 VA
	Permissible transit power AC 24 V for supply of field devices	Max. 12 VA
	Internal fuse	Thermal, automatic reset
External fusing	≤ 10 A	

Inputs (SELV)


Signal inputs D1 ... D4 (for volt-free contacts)	Contact voltage	DC 16 V
	Contact current	DC 5 mA
	Contact transfer resistance	Max. 100 Ω
	Contact insulation resistance	Min. 50 kΩ
	Switch time:	min. 20ms ON, min. 20ms OFF
Universal input X1	Compatible temperature sensors	LG-Ni 1000
	Measuring range	0...50 °C
	Sensor current	2.3 mA
	Resolution	≤ 0.2 K
	Measuring error (without cable)	± 0.2 K at 25° C
	or	
	Measuring input for DC 0 ... 10 V signals	
	Measuring range (nominal)	DC 0...10 V
	Over range	3.0 V
	Under range	0 V
Resolution	20 mV	
Sample rate	≤ 1 s	
Measured value input B2	Compatible temperature sensors	LG-Ni 1000
	Measuring range	0...50 °C
	Sensor current	2.3 mA
	Resolution	≤ 0.2 K
	Measuring error (without cable)	± 0.2 K at 25° C

Outputs (SELV)

Triac (Y1, Y2)	Output voltage	AC 24 V
	Output current	Max. 0.5 A
	Total nominal load (load on all outputs simultaneously)	Max. 12 VA
DC 0 ... 10 V (YC1...YC4)	Resolution	3 mV
	Accuracy	100 mV
	Output current	Max. 1.5 mA
Supply output G (SELV)	Voltage / Max. load	AC 24 V / Max. 6 VA
⚠ Relays (Q12, Q22)	Relay type	Monostable
	Contact rating with AC voltage	
	Max. switching power (resistive)	Max. AC 250 V, 1.8 KW

Interface to room unit	Number of room units connectable	1
	Interface type for room unit	PPS2
	for ACS	Bus
	PPS2 baud rate	4.8 kbit/s
	Baud rate on the LONWORKS bus	78 kbit/s

LONWORKS Bus	Interface type	LONMARK-compatible, electrically isolated
	Physical layer	FT 5000
Cable connections	Baud rate bus	78 kbit/s
	Bus topology and bus termination	See Installation guide, CA110334
	Plug-in terminal blocks	Rising cage terminals
	Solid conductors	1 x 0.2 ... 2.5mm ² or 2 x 0.2 ... 1.0 mm ²
	Stranded conductors without connector sleeves	1 x 0.2 ... 2.5mm ² or 2 x 0.2 ... 1.5 mm ²
	Stranded conductors with connector sleeves (DIN 46228/1)	1 x 0.25 ... 2.5mm ² or 2 x 0.25 ... 1.0 mm ²
	Single cable lengths for field devices	See also the RXC installation guide, CA110334
	Signal inputs D1...D4	Max. 100 m with diameters ≥ 0.6 mm
	Measured value input X1, B2	Max. 100 m with diameters ≥ 0.6 mm
	Triac outputs Y1...Y6	Max. 100 m where A ≥ 1.5 mm ²
DC 0...10 V outputs YC1...YC4	Max. 100 m where A ≥ 1.5 mm ²	
Relay outputs Q12, Q221	Depends on load and local regulations	
Interface to room unit	Max. 115 m where A= 0.75 mm ² (including connecting cable for tool)	
Housing protection standard	Cable type	4-core, twisted pair, unscreened
	LONWORKS Bus	See Installation guide, CA110334
	Cable type	See Installation guide, CA110334
	Tool connecting cable	See Installation guide, CA110334
Protection class	Protection standard to EN 60529	IP30 with terminal cover fitted and wall mounted without DIN rail IP20 for all other mounting arrangements
	Insulation protection class	III
Ambient conditions	Normal operation	Class 3K5 to IEC 60721-3-3
	Temperature	0 ... 50 °C
	Humidity	< 85 % r.h.
	Transport	Class 2K3 to IEC 60721-3-2
Standards and directives	Temperature	- 25 ... 65 °C
	Humidity	< 95 % r.h.
	Product standards	
	Automatic electronic controls for household and similar use	EN 60730-1
Electromagnetic compatibility		
Immunity (industrial & residential)	EN 60730-1	
Emission (residential)	EN 60730-1	
CE marking:		
EMC Directive	2004/108/EC	
Low Voltage Directive	2006/95/EC	
C-Tick conformity (EMC)	AS/NZS 61000-6-3	
Environmental compatibility	The product environmental declaration CA2E3840 contains data on environmentally compatible product design and assessments (RoHS compliance, materials composition, packaging, environmental benefit, disposal)	ISO 14001 (Environment) ISO 9001 (Quality) SN 36350 (Environmentally compatible products) 2002/95/EC (RoHS)
	See dimension diagrams	
Dimensions		
Weight	excluding packaging	0.270 kg
	including packaging	0.300 kg

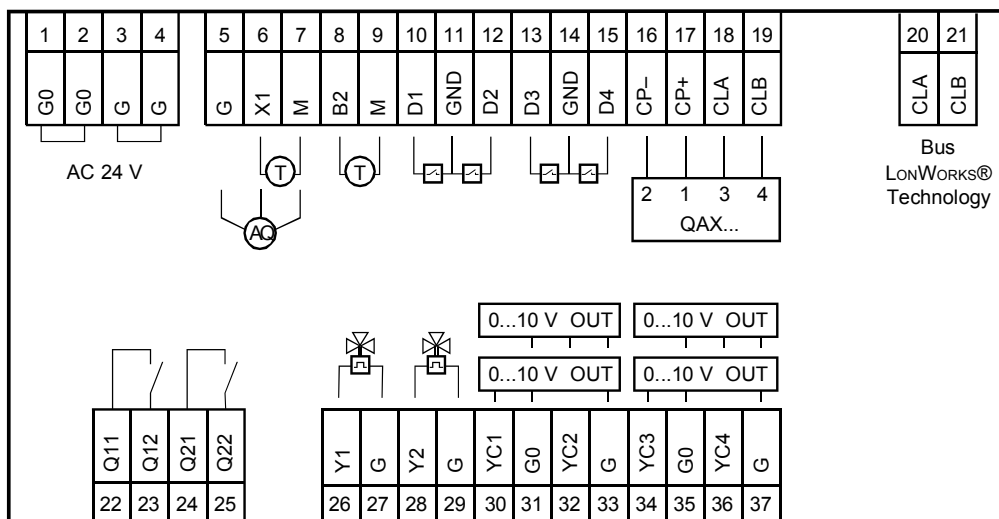

AC 24 V supply

- G0 1,2 Controller ground
- G 3,4 AC 24 V supply

Measured value input

- G 5 AC 24 V supply for sensors, actuators
- X1 6 Universal input (LG-Ni 1000, or DC 0...10 V for air quality sensor)
- M 7 Measured value input ground
- B2 8 Measured value input for LG-Ni 1000 sensors
- M 9 Measured value input ground

Signal inputs for volt-free contacts

- D1 10 Signal input
- GND 11 Signal ground
- D2 12 Signal input
- D3 13 Signal input
- GND 14 Signal ground
- D4 15 Signal input

Room unit

- CP- 16 PPS2 ground
- CP+ 17 PPS2 data
- CLA 18 LONWORKS Data A
- CLB 19 LONWORKS Data B

LONWORKS Bus

- CLA 20 LONWORKS Data A
- CLB 21 LONWORKS Data B

Relay outputs

- Q11 22 Feed for Q12
- Q12 23 Normally-open contact, max. AC 250 V, 1.8 kW
- Q21 24 Feed for Q22
- Q22 25 Normally-open contact, max. AC 250 V, 1.8 kW

Triac outputs

- Y1 26 AC 24 V, 0.5 A switching output
- G 27 AC 24 V actuator supply
- Y2 28 AC 24 V, 0.5 A switching output
- G 29 AC 24 V actuator supply

0 ... 10 V outputs

- YC1 30 DC 0 ... 10 V control output for actuator
- G0 31 Controller ground
- YC2 32 DC 0 ... 10 V control output for actuator
- G 33 AC 24 V supply for sensors, actuators
- YC3 34 DC 0 ... 10 V control output for actuator
- G0 35 Controller ground
- YC4 36 DC 0 ... 10 V control output for actuator
- G 37 AC 24 V supply for sensors, actuators


3856A02

Caution

- Observe the technical data for the relay outputs: max. AC 250 V, 1.8 KW
- External fuse (essential!): max. 10 A
- Local installation regulations must be observed.

Tool socket


Proprietary RJ45-type tool socket



- | | | | |
|---|-------------------------|---|----------|
| 1 | LonWorks®, Data A (CLA) | 5 | Not used |
| 2 | LonWorks®, Data B (CLB) | 6 | Not used |
| 3 | Not used | 7 | CP+ |
| 4 | Not used | 8 | CP- |

Connection diagram

Connection of field devices, room unit, bus and power supply

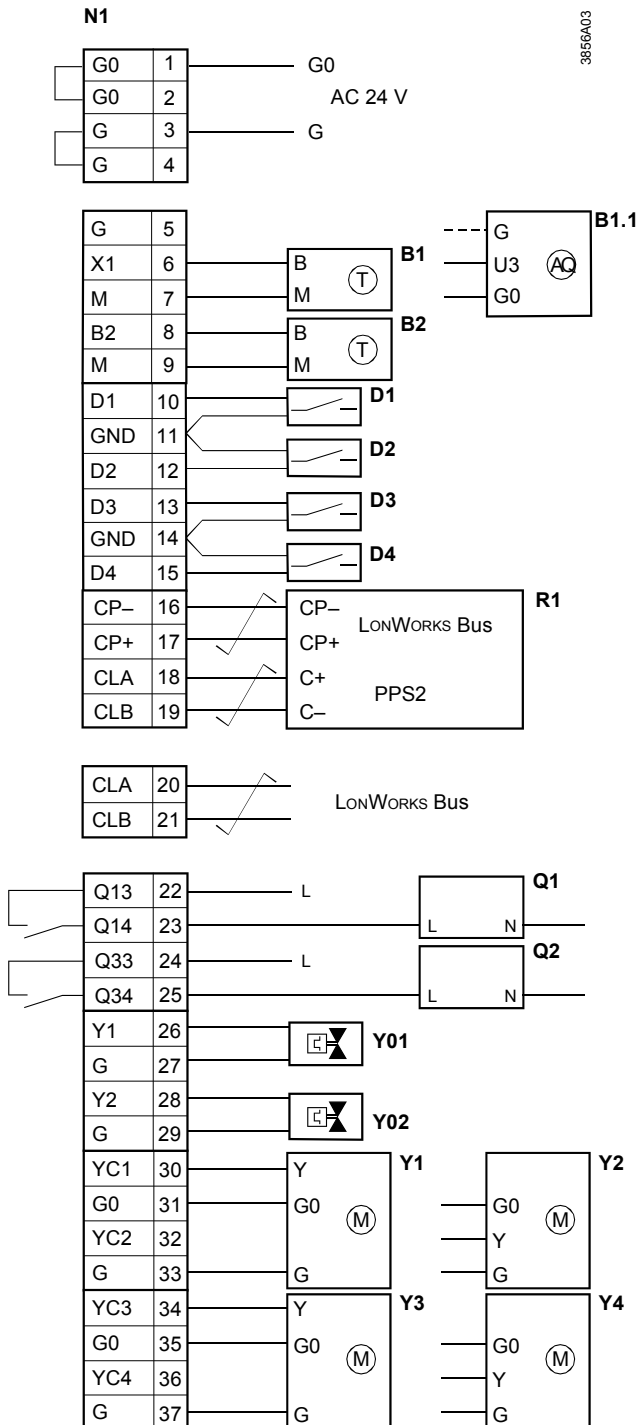

- N1 RXC39.5
- B1, B2 LG-Ni 1000 temperature sensor
- B1.1 Air quality sensor (DC 0...10 V)
- D1...D4 Volt-free contacts (window contact, occupancy sensor, etc.)
- R1 QAX... room unit
- Q1, Q2 AC 230 V loads
- Y01, Y02 Thermal actuators
- Y1...Y4 Motorized AC 24 V actuators

Twisted pair



Note!

For Q1, Q2, use external fuses of max. 10 A to protect the PCB tracks.

Notes

- Do not exceed the maximum simultaneous load on outputs Y1, Y2 (see "Engineering").
- A power amplifier may be used to connect additional valve actuators to Y1 and Y2 (see Desigo RXC installation guide, CA110334).
- For information on actuators compatible with the RXC39.5 controller, refer to the RX Hardware overview, N3804).
- The AC 24 V supply (G) for devices such as the DC 0 ... 10 V damper actuators, can be derived either from the controller or from an external source (see Desigo RXC installation guide CA110334). If the connected devices receive their supply from the controller the power consumption of these devices must be taken into account when sizing the transformer.

Parallel connection of several thermal actuators

Up to 2 thermal actuators can be connected directly to each triac output of the room controller. In the case of more than 2 actuators a power amplifier is required. The example holds for Y2 analogously.

Note that the simultaneous load on outputs Y1 and Y2 must not exceed 12 VA.

Power consumption at input X1 of the UA1T: 0.5 VA.




Note!

Mixed operation: **Connecting thermic actuators to the controller as well as to the power amplifier is NOT allowed.**


Differing voltage of the power supply of the controller and the supply of the power amplifier may cause big differences in the position of the valves.

Connection to controller

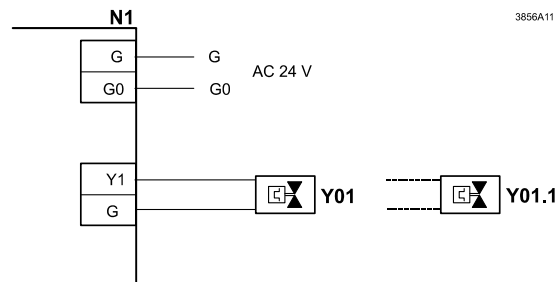

- N1 RXC39.5
- N2 UA1T (see data sheet CA2N3591)
- Y5 AC 24 V thermal valve actuator
- Y5.1 AC 24 V thermal valve actuator

Connection to power amplifier

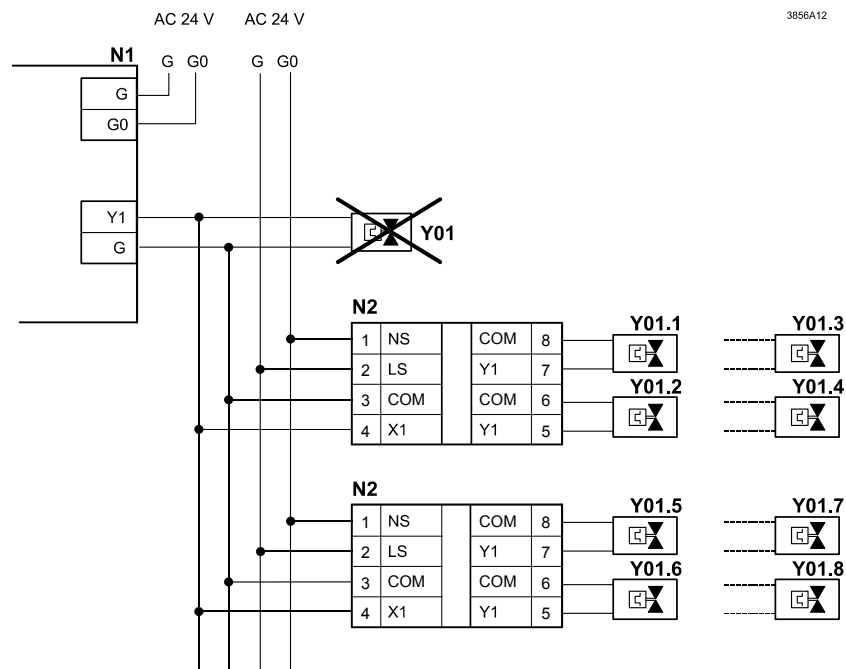

- N1 RXC39.5
- N2 UA1T (see data sheet CA2N3591)
- Y5 AC 24 V thermal valve actuator
- Y5.x AC 24 V thermal valve actuator (max. 2 STA72E / STP72E actuators per Y1 output on the UA1T)


Notes

- The UA1T requires an AC 24 V supply voltage
- The UA1T is *not* suitable for the connection of 3-position actuators.


Dimensions

Dimensions in mm

Without terminal covers

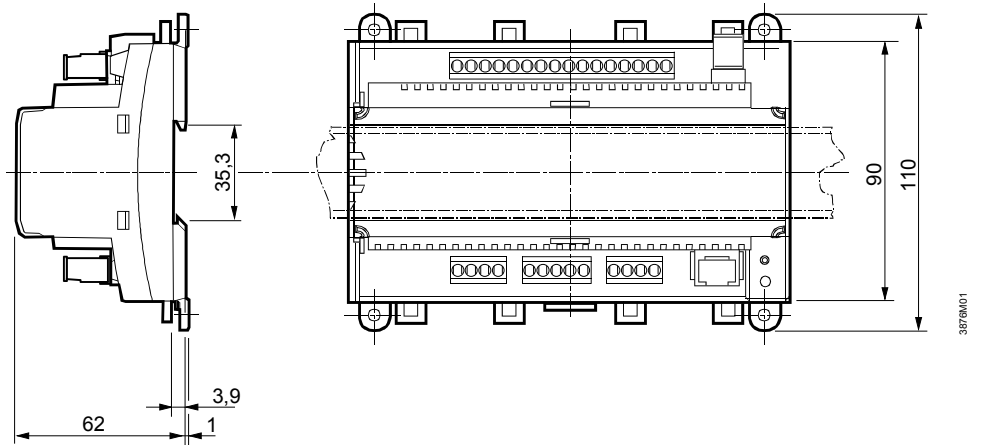

With terminal covers

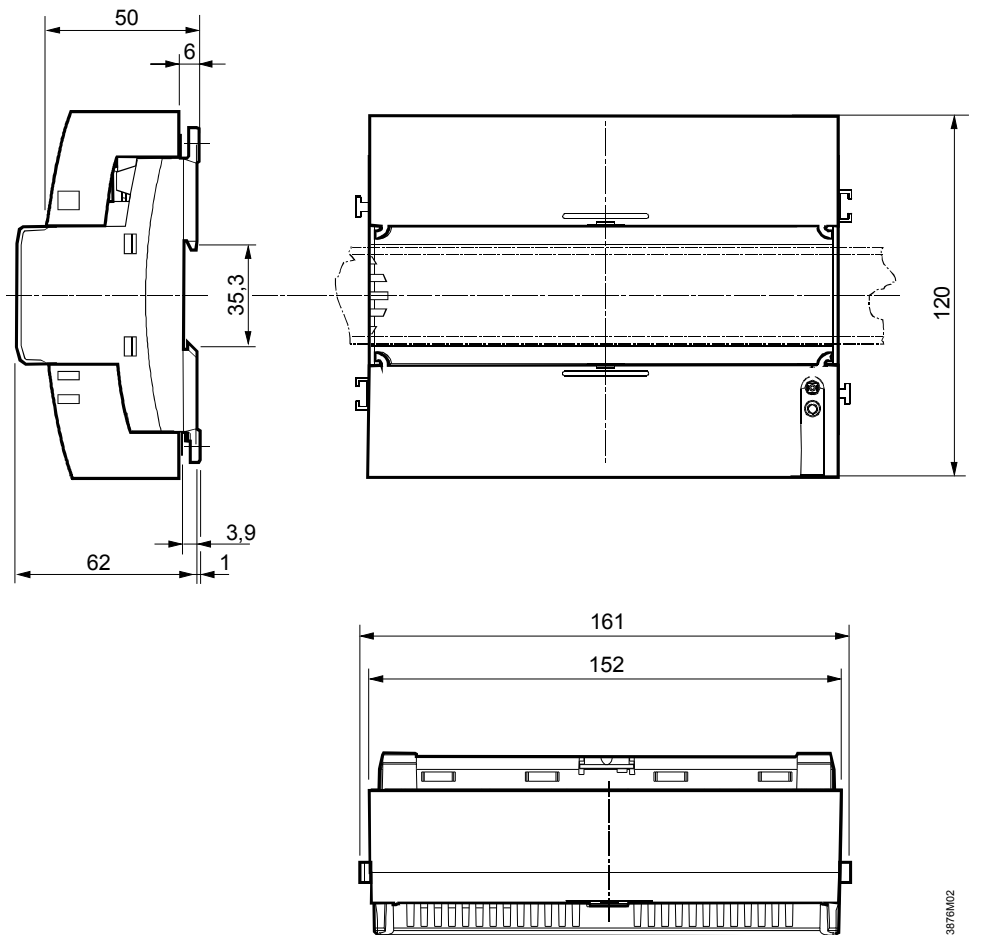

Drilling diagram

